



CONSTRUCTION NOTES

1. REFER TO BMP SITE EVALUATION TREATMENTS FORM FOR SPECIFIC DIMENSIONS THAT APPLY TO YOUR PROPERTY TO MEET TRPA'S BMP RETROFIT ORDINANCE.
2. IF RUNOFF FROM ROOF OR OTHER IMPERVIOUS SURFACES IS BEING INFILTRATED, THE AREA UNDER DECK MUST BE CONTAINED WITH A BORDER.
3. SUB-GRADE SHALL SLOPE 2% MINIMUM AWAY FROM FOUNDATION FOR 5'. ON STEEPER SLOPES, INSTALL TERRACES TO CONTAIN THE ROCK AND MINIMIZE SOIL DISTURBANCE.
4. 3/4" TO 1 1/2" DRAIN ROCK IS RECOMMENDED FOR ALL INFILTRATION SYSTEMS. NATIVE ROCK CAN BE SUBSTITUTED IF AVAILABLE.
5. FINISH GRADE OF ROCK SHALL BE AT LEAST 6" BELOW WOOD SIDING TO MAINTAIN WOOD AND EARTH SEPARATION REQUIRED BY LOCAL BUILDING CODES.
6. MATERIALS COMMONLY USED FOR CONTAINMENT BORDERS ARE PRESSURE TREATED LUMBER, REDWOOD, RECYCLED COMPOSITES, LANDSCAPE EDGING, OR COBBLES.
7. MAINTAIN BY KEEPING AREA CLEAR OF STORED MATERIALS (I.E. FIREWOOD, LUMBER, HOUSEHOLD ITEMS ETC.) AND REMOVE DEBRIS AS NECESSARY TO MAINTAIN FULL FUNCTION.

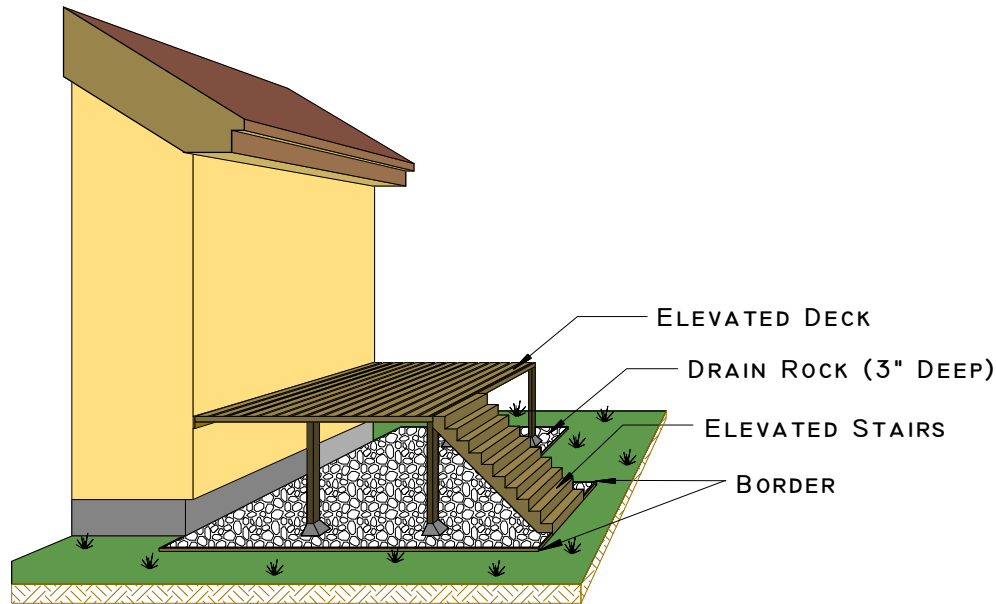

INSTALLATION GUIDELINES

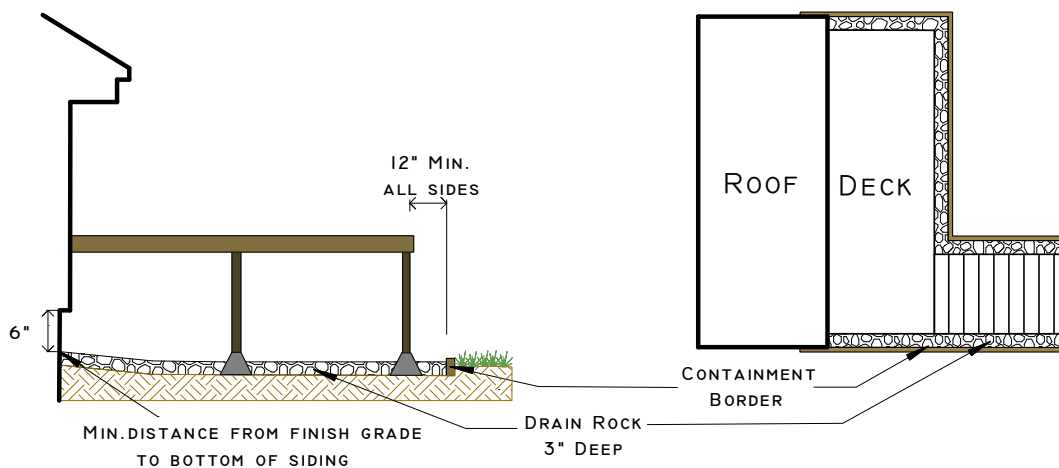

U.S. DEPARTMENT OF AGRICULTURE			
NATURAL RESOURCES CONSERVATION SERVICE			
IN COOPERATION WITH			
TAHOE RESOURCE CONSERVATION DISTRICT, AND NEVADA TAHOE CONSERVATION DISTRICT			
DRAWN BY:	DATE	APPROVED BY:	DATE
DMGG	12-5-06		

THIS SPECIFICATION IS BASED ON A REFERENCE TO THE NRCS STANDARD PRACTICE 570 - RUNOFF MANAGEMENT SYSTEMS.
USERS OF THESE DRAWINGS AND ASSOCIATED INFORMATION SHALL BE QUALIFIED PERSONNEL TRAINED TO INTERPRET AND ADAPT TECHNOLOGY ACCORDING TO LOCAL CONDITIONS.